

# BITZER Output data

Created on: 14.02.2019 21:11:34

14.02.2019 / All data subject to change.

2 / 10

## **Table of content**

Project survey	3
Selection: Semi-hermetic Reciprocating Compressors	. 4
Technical Data: 4EES-6Y	5
Information: Semi-hermetic Reciprocating Compressors	6
Selection: Horizontal receivers	8
Technical Data: F152H	9
Information: Liquid receiver	10



14.02.2019 / All data subject to change.

3 / 10

## **Project survey**

## Selected compressors

Semi-hermetic Reciprocating Compressors 1x 4EES-6Y

Chosen accessory

Horizontal receivers 1x F152H



14.02.2019 / All data subject to change.

4 / 10

## Selection: Semi-hermetic Reciprocating Compressors Input Values

Compressor model 4EES-6Y

Mode Refrigeration and Air


conditioning

Refrigerant R134a

Reference temperature
Evaporating SST
-10,00 °C
Condensing SDT
45,0 °C
Liq. subc. (in condenser)
Suction gas temperature
Operating mode
Power supply

Dew point temp.
10,00 °C
45,0 °C
45,0 °C
45,0 °C
Auto
Auto
Auto
Auto

Capacity Control 100% Useful superheat 100%

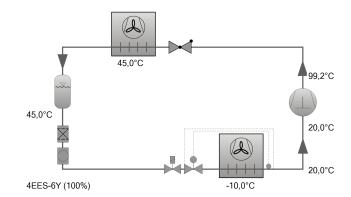


#### Result

Compressor	4EES-6Y-40S
Capacity steps	100%
Cooling capacity	6,78 kW
Cooling capacity *	6,78 kW
Evaporator capacity	6,78 kW
Power input	2,82 kW
Current (400V)	6,16 A
Voltage range	380-420V
Condenser Capacity	9,60 kW
COP/EER	2,40
COP/EER *	2,40
Mass flow	158,7 kg/h
Operating mode	Standard
Discharge gas temp. w/o cooling	99,2 °C

#### Tentative Data.

\*According to EN12900 (20°C suction gas temp., 0K liquid subcooling)

### **Application Limits 100% 4EES-6**

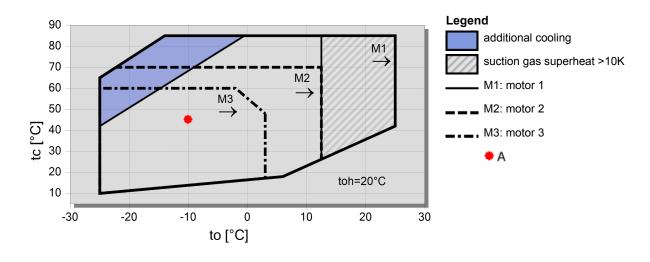





14.02.2019 / All data subject to change. BITZER Software v6.9.1 rev2074


5 / 10

#### **Technical Data: 4EES-6Y**

#### **Dimensions and Connections**







#### **Technical Data**

Tecl	hnical	Data
------	--------	------

Displacement (1450 RPM 50Hz) 22,72 m3/h Displacement (1750 RPM 60Hz) 27,42 m3/h

No. of cylinder x bore x stroke 4 x 46 mm x 39,3 mm 86 kg

Weight

Max. pressure (LP/HP) 19 / 32bar 28 mm - 1 1/8" Connection suction line Connection discharge line 16 mm - 5/8"

BSE32(Standard) / R134a tc>70°C: BSE55 (Option) Oil type R134a/R407C/R404A/R507A/R407A/R407F

Oil type R22 (R12/R502) B5.2 (Option)

**Motor data** 

Motor version

Motor voltage (more on request) 380-420V Y-3-50Hz

Max operating current 13.6 A Starting current (Rotor locked) 62.2 A Max. Power input 7,6 kW

**Extent of delivery (Standard)** 

Motor protection SE-B1 Enclosure class IP66 Vibration dampers Standard Oil charge 2,00 dm3

**Available Options** 

Discharge gas temperature sensor Option

Capacity control 100-50% (Option) Capacity Control - infinite 100-10% (Option) Additional fan

Option Crankcase heater 0..120 W PTC (Option) Oil level monitoring OLC-K1 (Option)

Sound measurement

Sound power level (+5°C / 50°C) Sound power level (-10°C / 45°C) Sound power level (-35°C / 40°C) 68,2 dB(A) @ 50Hz 71,6 dB(A) @ 50Hz 72,5 dB(A) @ 50Hz 60,2 dB(A) @ 50Hz Sound pressure level @ 1m (+5°C / 50°C) Sound pressure level @ 1m (-10°C / 45°C) 63,6 dB(A) @ 50Hz Sound pressure level @ 1m (-35°C / 40°C) 64,5 dB(A) @ 50Hz



BITZER Software v6.9.1 rev2074

## MFM-REF https://www.mfmref.com info@mfmref.com

14.02.2019 / All data subject to change.

6 / 10

## **Semi-hermetic Reciprocating Compressors**

**Motor 1 =** e.g. 4TES-12 with 12 "HP", primary for air-conditioning (e.g. R22,R407C) and air-conditioning with R134a at high ambient temperatures.

**Motor 2 =** e.g. 4TES-9 with 8 "HP", universal Motor for medium and low temperature application (e.g. R404A, R507A, R407A, R407F) and air-conditioning with R134a

Motor 3 = e.g. 4TES-8, for medium temperature applications and R134a

For more information concerning the application range use the "Limits" button.

#### Operation modes 4VES-7 to 6FE-44 and 44JE-30 to 66FE-88 with R407F/R407A/R22

CIC = liquid injection with low temperature application, suction gas cooled motor.

### ASERCOM certified performance data

The Association of European Refrigeration Component Manufacturers has implemented a procedure of certifying performance data. The high standard of these certifications is assured by:

- \* plausibility tests of the data performed by experts.
- \* regular measurements at independent institutes.

These high efforts result in the fact that only a limited number of compressors can be submitted. Due to this not all BITZER compresors are certified until now. Performance data of compressors which fulfil the strict requirements may carry the label "ASERCOM certified". In this software you will find the label at the respective compressors on the right side below the field "result" or in the print out of the performance data. All certified compressors and further information are listed on the homepage of ASERCOM.

#### Condensing capacity

The condensing capacity can be calculated with or without heat rejection. This option can be set in the menu Program  $\Box$  Options. The heat rejection is constantly 5 % of the power consumption. The condensing capacity is to be found in the line Condensing cap. (with HR) resp. Condensing capacity.

#### Data for sound emission

Data based on 50 HZ apllication (IP-units 60 Hz) and R404A if not declared.

Sound pressure level: values based on free field area conditions with hemisperhical sound emission in 1 meter distance.

#### General remarks regarding sound data

Listed sound data were measured under testing conditions in our laboratory. For this purpose the free-standing test sample is mounted on a solid foundation plate and the pipework is connected vibration-free to the largest extend possible. Suction and discharge lines are fixed in a flexible configuration, such that a transmission of vibrations to the environment can be largely excluded. In real installations considerable differences might be observed, compared to the measurements in the laboratory. The airborne sound emitted by the compressor can be reflected from surfaces of the system and this may increase the airborne sound level measured close to the compressor. Vibrations caused by the compressor are also transferred to the system by the compressor feet and piping depending on the damping ratio of the fixings. Thus, the vibrations can induce other components to such an extent that these components contribute to an increase in airborne sound emission. If required, the transfer of vibrations to the system can be minimized by suitable fixing and damping elements.

#### Legend of connection positions according to "Dimensions":

- 1 High pressure connection (HP)
- 2 Connection for discharge gas temperature sensor (HP) (for 4VE(S)-6Y .. 4NE(S)-20(Y) connection for CIC sensor as alternative)
- 3 Low pressure connection (LP)
- 4 CIC system: injection nozzle (LP)
- 4b Connection for CIC sensor
- 4c Connection for CIC sensor (MP / operation with liquid subcooler)
- 5 Oil fill plug
- 6 Oil drain
- 7 Oil filter (magnetic screw)
- 8 Oil return (oil separator)
- 8\* Oil return with NH3 and insoluble oil
- 9 Connection for oil and gas equalization (parallel operation)
- 9a Connection for gas equalization (parallel operation)
- 9b Connection for oil equalization (parallel operation)
- 10 Oil heater connection
- 11 Oil pressure connection +
- 12 Oil pressure connection -
- 13 Cooling water connection
- 14 Intermediate pressure connection (MP)
- 15 Liquid injection (operation without liquid subcooler and with thermostatic expansion valve)
- 16 Connection for oil monitoring (opto-electrical oil monitoring "OLC-K1" or differential oil pressure switch "Delta-PII")



BITZER Software v6.9.1 rev2074

14.02.2019 / All data subject to change.

7 / 10

- 17 Refrigerant inlet at liquid subcooler 18 Referigerant outlet at liquid subcooler
- 19 Clamp space
- 20 Terminal plate
- 21 Maintenance connection for oil valve
- 22 Pressure relief valve to the atmosphere (discharge side)
- 23 Pressure relief valve to the atmosphere (suction side)
- 24 IQ MODULE
- SL Suction gas line
- DL Discharge gas line
- Dimensions can show tolerances according to EN ISO 13920-B.



BITZER Software v6.9.1 rev2074

14.02.2019 / All data subject to change.

8 / 10

## **Selection: Horizontal receivers**

#### Input Values

Common Yes

Auto

Operating point Auto

## **Operating Points**

Α

to [°C] -10 tc [°C] 45

#### Result

Compressor: 4EES-6Y
Recommendation: F152H
Selection F152H

Recommended operating point: A
Selected operating point: A

Receiver volume 15,00 dm³ max refrigerant charge 16,60 kg receiver load 74,8 %

Receiver unit mounted compl. lower fixing rails 327301-04 upper fixing rails 327301-22 upper fixing plate 320366-02

#1: Receiver selection for compact systems without condensing pressure control. Precise calculation only via refrigerant charge (see notes).




14.02.2019 / All data subject to change.

9 / 10

## **Technical Data: F152H**

## **Dimensions and Connections**

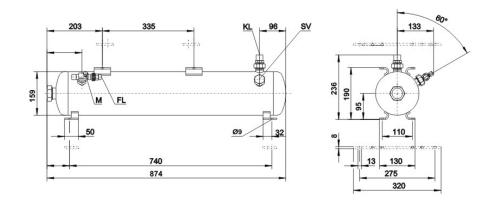

### **Technical Data**

Technical Data	
Weight	15,5 kg
Total width	874 mm
Total depth	212,5 mm
Total height	236mm
Receiver volume refrigerant	15,0 l
Max. refrigerant charge 90% at 20°C / 68°F	
R22	16,3 kg
R134a	16,6 kg
R407C	15,6 kg
R404A/R507A	14,4 kg
R448A	15,0 kg
R449A	15,1 kg
R450A	16,1 kg
R513A	16,5 kg
Max. pressure	33 bar
Max. Operating Temperature	120°C
Connection inlet KL	22mm - 7/8"
Connection thread/ -flange	1 1/4" - 12 UNF
Connection outlet FL	16mm - 5/8"
Connection thread/ -flange	1" - 14 UNS
Gauge	7/16" 20UNF
Connection for pressure relief valve	1 1/4"-12UNF
Adapter for pressure relief valve	Option
Minimum level control	Option
Maximum level control	Option
*According PED 2014/68/EU	Standard
Special Approvals (on request)	Option



BITZER Software v6.9.1 rev2074

## MFM-REF https://www.mfmref.com info@mfmref.com

14.02.2019 / All data subject to change.

10 / 10

#### Selection of the receivers:

#### 1) "Approx. according to cooling capacity":

The receiver volume is determined by the design of the unit, the operating mode and the function of the receiver (receiving the complete refrigerant charge in the receiver or only compensating capacity variations). When selected via cooling capacity, an approximate selection of the receiver is obtained. Receivers in systems with long pipelines, winter control or in very compact systems should be selected according to method 2).

#### 2) "According to refrigerant charge in the receiver":

The calculation is made on the basis of the specified refrigerant charge. The receiver volume is determined at 20°C and at a maximum filling charge of 95% of the possible receiver content.

Compressor units equipped with receiver

The BITZER range of products comprises compressor units with horizontal receivers. In the output window of the accessories these units, which are included in the standard delivery, are marked with "mounted" in the compressor unit line. Units that can be mounted, but are not included in the Bitzer delivery program, are marked with "single parts". Units in which the compressor does not fit onto the receiver are marked with "--".